



Experiments on Evaporative Emissions in Ventilated Rooms

Topp, Claus; Nielsen, Peter V.; Heiselberg, Per; Sparks, L. E. ; Howard, E. M. ; Mason, M.

Publication date:
1998

Document Version
Publisher's PDF, also known as Version of record

[Link to publication from Aalborg University](#)

Citation for published version (APA):

Topp, C., Nielsen, P. V., Heiselberg, P., Sparks, L. E., Howard, E. M., & Mason, M. (1998). *Experiments on Evaporative Emissions in Ventilated Rooms*. Dept. of Building Technology and Structural Engineering. Indoor Environmental Engineering Vol. R9835 No. 93

General rights

Copyright and moral rights for the publications made accessible in the public portal are retained by the authors and/or other copyright owners and it is a condition of accessing publications that users recognise and abide by the legal requirements associated with these rights.

- Users may download and print one copy of any publication from the public portal for the purpose of private study or research.
- You may not further distribute the material or use it for any profit-making activity or commercial gain
- You may freely distribute the URL identifying the publication in the public portal -


Take down policy

If you believe that this document breaches copyright please contact us at vbn@aub.aau.dk providing details, and we will remove access to the work immediately and investigate your claim.

Experiments on

Evaporative Emissions in Ventilated Rooms

*C. Topp, P. V. Nielsen, P. Heiselberg,
L. E. Sparks, E. M. Howard, M. Mason*

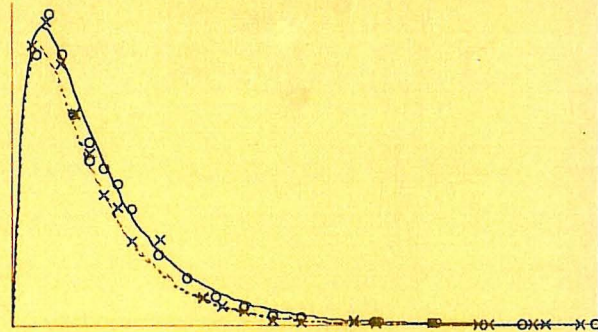

Paper No 93

Indoor Environmental Engineering

In: Proceedings of ROOMVENT'98, Sixth International
Conference on Air Distribution in Rooms, Stockholm,
Sweden 1998, Vol. 1, pp. 499-505

The ***Indoor Environmental Engineering*** papers are issued for early dissemination of research results from the Indoor Environmental Engineering Group at the Department of Building Technology and Structural Engineering, Aalborg University. These papers are generally submitted to scientific meetings, conferences or journals and should therefore not be widely distributed. Whenever possible, reference should be given to the final publications (proceedings, journals, etc.) and not to the Indoor Environmental Engineering papers.

Experiments on Evaporative Emissions in Ventilated Rooms

*C. Topp, P. V. Nielsen, P. Heiselberg,
L. E. Sparks, E. M. Howard, M. Mason*

EXPERIMENTS ON EVAPORATIVE EMISSIONS IN VENTILATED ROOMS

C. Topp¹, P. V. Nielsen¹, P. Heiselberg¹, L. E. Sparks², E. M. Howard², M. Mason²

¹Indoor Environmental Engineering, Aalborg University, DENMARK

²U.S Environmental Protection Agency, National Risk Management Research Laboratory,
Indoor Environment Management Branch, North Carolina, USA

ABSTRACT

In many new buildings the indoor air quality is affected by emissions of volatile organic compounds (VOCs) from building materials. The emission process may be controlled either by diffusion inside the material or evaporation from the surface but it always involves mass transfer across the boundary layer at the surface-air-interface.

Experiments at different velocity levels were performed in a full-scale ventilated chamber to investigate the influence of local airflow on the evaporative emission from a surface. The experiments included velocity measurements in the flow over the surface and measurements of chamber air concentrations.

The results show that the emission, expressed in terms of the mass transfer coefficient, increases with velocity for fixed temperature, relative humidity and air exchange rate. This emphasises the importance of testing materials at the correct velocity and turbulence level in order to obtain the actual emission rate for a given product.

KEYWORDS

Full-scale experiments, emission of VOCs, CFD

INTRODUCTION

Emissions of volatile organic compounds (VOCs) from building materials such as paint, linoleum, carpets, sealant and lacquer affect the indoor air quality in many new buildings. People exposed to the VOCs may report a decreased acceptability of the

indoor air quality, irritation of mucous membranes and general symptoms such as fatigue and headache.

The emissions occur in a chainlike process: diffusion inside the emitting material; crossing the surface-air-interface; transport across the mass transfer boundary layer; and mixing into the bulk air. In any particular material one of these processes may be rate controlling. For freshly applied liquid films the emission is generally controlled by evaporation from the surface and depends on local airflow parameters such as temperature and velocity.

Assuming that emission of VOC's from a surface is limited by molecular diffusion through the boundary layer at the surface-air-interface, Fick's law describes the emission:

$$E = k_c(C_s - C) \quad (1)$$

where E = emission rate
 k_c = mass transfer coefficient
 C_s = concentration at surface
 C = concentration in bulk air

The mass transfer coefficient, k_c , can also be expressed in terms of the molecular diffusion coefficient, D , and the thickness of the diffusion boundary layer, δ_D , where $k_c = D/\delta_D$.

For a freshly applied surface the surface concentration is equal to the equilibrium vapour pressure, C_v , and as the surface ages the concentration decreases. The surface concentration is assumed to be

proportional to the amount of VOC remaining in the source (Tichenor et al. 1993):

$$C_s = C_v \frac{M}{M_0} \quad (2)$$

where C_v = vapour pressure at surface
 M = mass remaining in source
 M_0 = initial mass in source

In a room or chamber the concentration of VOC in the air changes as VOC is emitted from the surface. Assuming that the VOC emission is limited by molecular diffusion through the boundary layer at the surface-air-interface, the mass balance equation for VOC in the chamber air is

$$V \frac{dC}{dt} = Ak_c \left(C_v \frac{M}{M_0} - C \right) - QC \quad (3)$$

where V = chamber volume
 t = time
 A = source area
 Q = air flow rate

The change of mass in the source equals minus the emission rate and thus the mass balance for VOC in the source is given by:

$$\frac{dM}{dt} = k_c \left(C - C_v \frac{M}{M_0} \right) \quad (4)$$

Equations 3 and 4 provide the full mass balance of the VOCs.

In analogue to heat transfer the mass transfer coefficient can be described by a dimensionless parameter:

$$Sh_L = \frac{k_c L}{D} \quad (5)$$

where Sh_L = Sherwood number
 L = characteristic length
 D = molecular diffusion coefficient

From boundary layer theory (Sissom and Pitts 1972) the Sherwood number for laminar flow past a flat plate can be approximated by

$$Sh_L = 0.664 Re_L^{1/2} Sc^{1/3} \quad (6)$$

and for turbulent flow

$$Sh_L = 0.0365 Re_L^{4/5} Sc^{1/3} \quad (7)$$

where Re_L = Reynolds number (uL/ν)
 Sc = Schmidt number (ν/D)
 u = velocity
 ν = kinematic velocity

The mass transfer coefficient is thus a function of Re_L and varies with $u^{1/2}$ for laminar flow and $u^{4/5}$ for turbulent flow.

Zhang et al. (1996) and Zhang and Haghighat (1996) have studied the effect of air velocity and turbulence on VOC emissions from surfaces in small-scale test chambers. As a difference in scale may lead to different emission rates (see Topp et al. 1997) the present work focuses on experiments in a full-scale ventilated chamber.

It has been the objective to investigate the influence of local airflow over an emitting surface through full-scale experiments. The experiments are compared qualitatively with results from Computational Fluid Dynamics (CFD) (Topp et al. 1997).

METHODS

Experiments were performed in a full-scale ventilated chamber with dimensions, length, width and height respectively, 4.0 m by 2.8 m by 2.6 m and a volume of 30 m³ (see figure 1) (Howard et al. 1995).

Four slots provide supply air to the chamber, one at the foot of each wall. The chamber has been modified so that three of the inlet slots direct the flow upward along the wall and the fourth inlet slot directs the flow along the floor. The return is located at the centre of the ceiling.

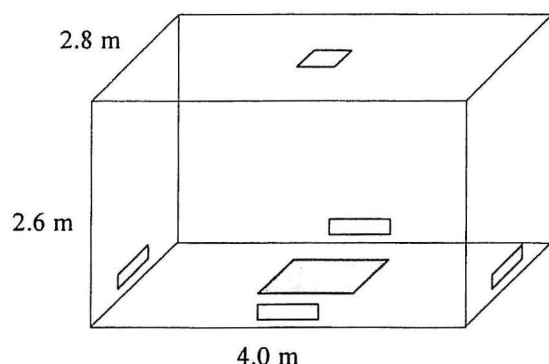


Figure 1 Outline of full-scale chamber.

The experiments were performed at two different velocity levels with temperature and relative humidity kept fixed. In all experiments the air exchange rate was $N = 1 \text{ h}^{-1}$ and the amount of recirculating air was changed to obtain different velocity levels in the chamber. Two experiments were performed at a total supply flow rate of $N^* = 5 \text{ h}^{-1}$ (recirculation rate of 4 h^{-1}) and two experiments were performed at $N^* = 2 \text{ h}^{-1}$ (recirculation rate of 1 h^{-1}) (see table 1).

Table 1 Experiment parameters.

Experiment	N (h^{-1})	N^* (h^{-1})	M_0 (g/m^2)
1	1	5	44.0
2	1	5	39.0
3	1	2	35.7
4	1	2	34.8

In each of the experiments, a wood board of 1.48 m^2 (1.22 m by 1.22 m) was placed at the centre of the chamber floor. After conditioning the wood board to the test conditions, VOC was applied to the top surface. The VOC applied was pure decane ($\text{C}_{10}\text{H}_{22}$), with equilibrium vapour pressure $C_v = 12115 \text{ mg/m}^3$ and molecular diffusion coefficient $D = 0.0207 \text{ m}^2/\text{h}$. Table 1 shows the amount of decane applied in each experiment.

The concentration of decane in the chamber air was determined by gas chromatography. Chamber air was pulled through sorbing traps at a known flow rate using mass flow controllers and a vacuum pump. Analytes were extracted from the traps with

carbon disulfide (CS_2), and the concentration of decane in the extract was determined by injecting a subsample of the extract onto the column of a gas chromatograph equipped with a mass selective detector.

Smoke tests showed that the flow over the wood board was parallel to the surface. Velocity profiles were measured to obtain detailed knowledge of the boundary layer flow over the wood board. The profiles were measured with a hot-wire anemometer at the centre of the wood board and at 250 mm east, west, north and south of the centre respectively (see figure 2).

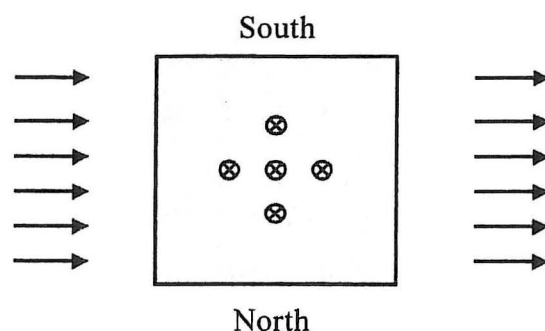


Figure 2 Outline of locations for measuring velocity profiles over the wood board.

RESULTS

Velocity

The velocity profiles over the wood board are shown in figure 3 and 4. As expected, the velocity level, i.e. the maximum velocity decreases with distance from the inlet. The velocity levels at the north and south locations though, are much different indicating that the flow is not symmetric around the board centerline. The difference is increased with the flow rate.

For $N^* = 2 \text{ h}^{-1}$ the maximum velocities occur approximately 3 cm above the surface and 2 cm above the surface for $N^* = 5 \text{ h}^{-1}$. As the flow rate is decreased the maximum velocity in center, east and west locations drops accordingly (see table 2).

Table 2 Maximum velocities over the wood board.

N^* (h^{-1})	Center (m/s)	East (m/s)	West (m/s)	North (m/s)	South (m/s)
2	0.27	0.32	0.22	0.23	0.17
5	0.78	0.86	0.64	0.91	0.29

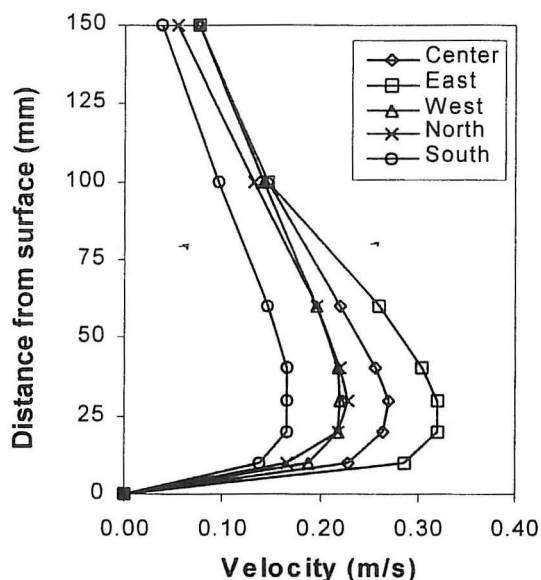


Figure 3 Velocity profiles over the wood board for $N^* = 2 \text{ h}^{-1}$.

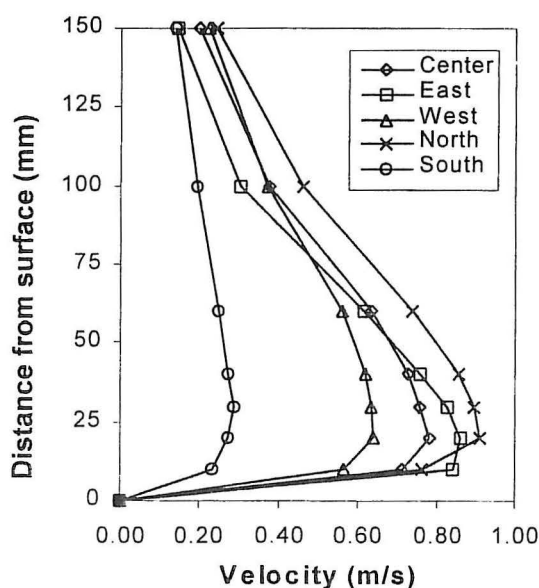


Figure 4 Velocity profiles over the wood board for $N^* = 5 \text{ h}^{-1}$.

Concentration

The measured chamber concentrations over time are shown in figures 5 and 6 as well as the prediction from the mass transfer model developed by Tichenor et al. (1993).

The chamber concentration reaches its maximum after approximately 0.5 h for $N^* = 2 \text{ h}^{-1}$ and after 1 h for $N^* = 5 \text{ h}^{-1}$. Then the concentration drops rapidly within 10 h.

In the early stage of the emission process there is a significant difference between concentrations from one velocity level to another but after approximately 2 h the concentration levels are very similar.

In general, there is good agreement between the experimental data and the model prediction but the model seems to predict lower peak concentrations.

Concentrations from experiments with the same total supply flow rate are very similar although there is a 10 % difference between the peak concentrations for $N^* = 2 \text{ h}^{-1}$. For $N^* = 5 \text{ h}^{-1}$ there is a difference of 12 % in the amount of VOC applied but the difference in concentration is not as significant.

Mass transfer

The emission rate can be conveniently expressed in terms of a mass transfer coefficient (equation 1). In the present work the mass transfer coefficient has been obtained through non-linear regression by fitting the experimental data to the solutions of equations 3 and 4 (see table 3).

Table 3 Mass transfer coefficients from non-linear regression.

Experiment	k_c (m/h)	Std. Dev. (m/h)	Std. Dev. (%)
1	10.29	0.84	8.2
2	11.07	1.29	11.7
3	4.01	0.19	4.7
4	3.64	0.21	5.8

The standard deviations from the regressions are within 12 %, which is satisfactory. The mass transfer coefficients from experiments with identical flow rates agree within 10 %.

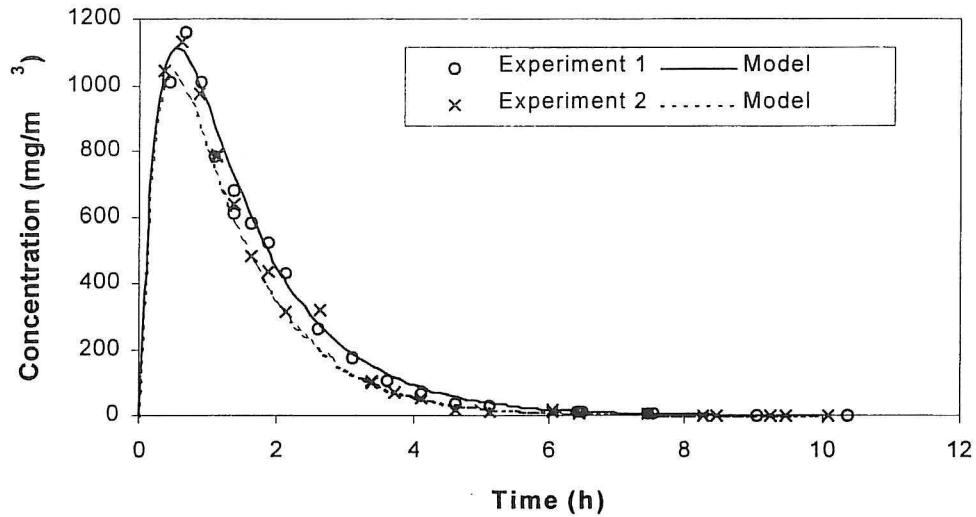


Figure 5 Measured concentration in the chamber air and model predictions (Tichenor et al. 1993) for $N^* = 5 \text{ h}^{-1}$.

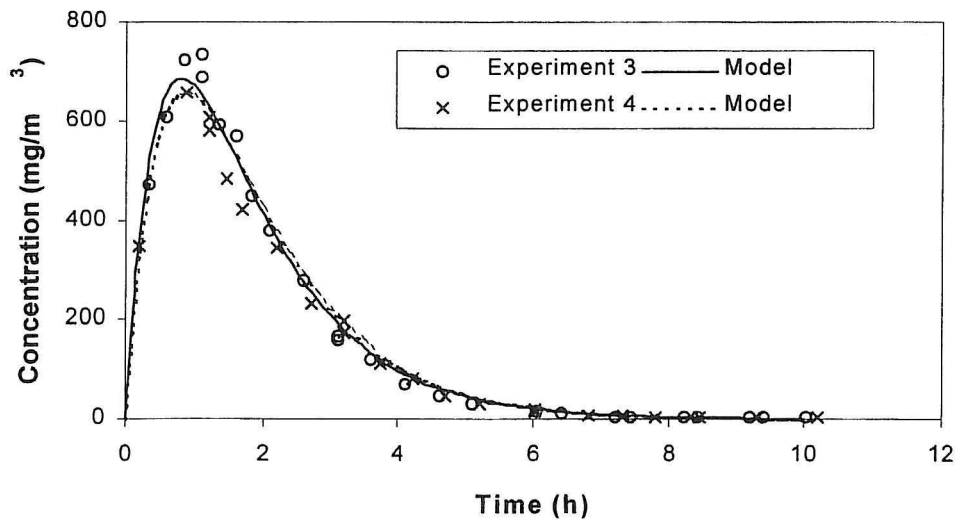


Figure 6 Measured concentration in the chamber air and model predictions (Tichenor et al. 1993) for $N^* = 2 \text{ h}^{-1}$.

For comparison of mass transfer coefficients from experiments with different velocity levels the average of the maximum velocities in center, north and south locations is used as reference velocity (see figure 7).

Topp et al. (1997) performed a series of CFD calculations on emission in a full-scale ventilated room and a test chamber using a Low Reynolds Number (LRN)

formulation of the $k-\epsilon$ turbulence model. Results from the full-scale room with the pollutant source located at the ceiling and the test chamber are included in figure 7.

The experiments in the present work were performed at Schmidt number $Sc = 2.6$ while $Sc = 1.0$ in the CFD calculations by Topp et al. (1997) and thus only allows for qualitative comparison.

From the figure it appears that

increasing the velocity yields a proportional increase in mass transfer coefficient.

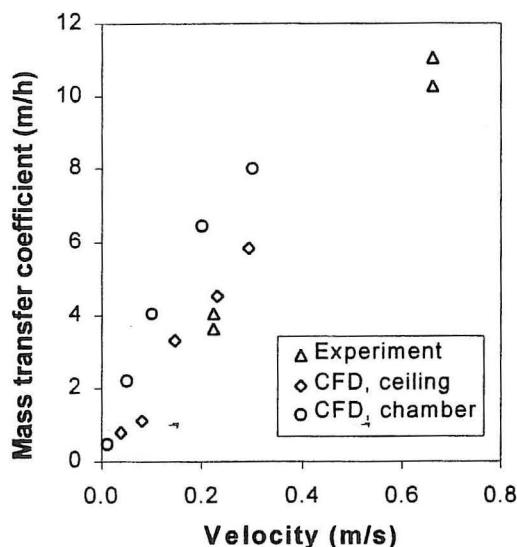


Figure 7 Relation between mass transfer coefficient and velocity. CFD results from Topp et al. (1997) included.

DISCUSSION

Experiments were performed in a full-scale ventilated chamber at two different velocity levels to investigate the effect of local airflow on the evaporative emission from a surface.

The results agree with the model predictions by Tichenor et al. (1993) and show that after reaching its maximum the chamber concentration drops rapidly within 10 h, which is consistent with the results obtained by Chang and Guo (1992). They studied the emission characteristics of a mixture of organic compounds, including decane, and concluded that the first phase of the emission process is mainly controlled by evaporation from the surface. After that the decay rate slows down, as diffusion transport inside the material becomes the controlling mechanism of the emission process.

Two experiments were performed at each velocity level and the results are consistent indicating a high level of repeatability.

It was found that the velocity level in the boundary layer flow over the surface has a strong impact on the mass transfer coefficient as the mass transfer coefficient increases in proportion to the velocity. This emphasises the importance of testing materials at the correct velocity and turbulence level to overcome scaling problems when transferring results from a small-scale test chamber to a full-scale ventilated room.

A source of error is introduced as the mass transfer coefficient has been obtained from a best-fit method. The standard deviation on the mass transfer coefficient is in all experiments less than 12 %.

ACKNOWLEDGEMENTS

This research work has been supported financially by the Danish Technical Research Council (STVF) as a part of the research program "Healthy Buildings". All experiments were performed at the U.S. Environmental Protection Agency, National Risk Management Research Laboratory, Indoor Environment Management Branch, North Carolina, USA.

REFERENCES

- Chang, J. C. S. and Guo, Z. (1992) Characterization of organic emissions from a wood finishing product – wood stain. *Indoor Air*, 1992, 2.
- Howard, E. M., Mason, M., Zhang, J. and Brown, S. (1995) A comparison of design specifications for three large environmental chambers. *Engineering solutions to indoor air quality problems*, VIP-51, Air & Waste Management Association: Pittsburgh, 1995, pp. 61-70.
- Nielsen, P. V. (1995) Healthy buildings and air distributions in rooms. *Proceedings Healthy Buildings 1995*. Milan, Italy.
- Sissom, L. E. and Pitts, D. R. (1972) *Elements of Transport Phenomena*. McGraw-Hill, Inc., 1972.

Sparks, L. E., Tichenor, B. A., Chang, J. and Guo, Z. (1996) Gas-phase mass transfer model for predicting volatile organic compound (VOC) emission rates from indoor pollutant sources. *Indoor Air*, 1996, 6.

Tichenor, B. A., Guo, Z. and Sparks, L. E. (1993) Fundamental mass transfer model for indoor air emissions from surface coatings. *Indoor Air*, 1993, 3.

Topp, C., Nielsen, P. V. and Heiselberg, P. (1997) Evaporation controlled emission in ventilated rooms. *Proceedings Healthy Buildings/IAQ'97*. Washington DC, USA.

Zhang, J. S., Shaw, C. Y., Kanabus-Kaminska, J. M., MacDonald, R. A., Magee, R. J., Luszyk, E. and Weichert, H. J. (1996) Study of air velocity and turbulence effects on organic compound emissions from building materials/furnishings using a new small test chamber. *Characterizing sources of indoor air pollution and related sink effects, ASTM STP 1287*, Bruce A. Tichenor, Ed., American Society for Testing and Materials, 1996, pp. 184-199.

Zhang, Y. and Haghighat, F. (1996) A small air velocity-controlled test chamber for emission studies. *Characterizing sources of indoor air pollution and related sink effects, ASTM STP 1287*, Bruce A. Tichenor, Ed., American Society for Testing and Materials, 1996, pp. 23-33.

RECENT PAPERS ON INDOOR ENVIRONMENTAL ENGINEERING

PAPER NO. 79: P.V. Nielsen: *Design of Local Ventilation by Full-Scale and Scale Modelling Techniques*. ISSN 1395-7953 R9743.

PAPER NO. 80: P. Heiselberg, K. Svidt, H. Kragh: *Application of CFD in Investigation of Ventilation Strategies for Improvement of Working Environment in a Waste Incineration Plant*. ISSN 1395-7953 R9745.

PAPER NO. 81: P. Heiselberg, C. Topp: *Removal of Airborne Contaminants from a Surface Tank by a Push-Pull System*. ISSN 1395-7953 R9746.

PAPER NO. 82: P. Heiselberg: *Simplified Method for Room Air Distribution Design*. ISSN 1395-7953 R9747.

PAPER NO. 83: L. Davidson, P.V. Nielsen: *A Study of Laminar Backward-Facing Step Flow*. ISSN 1395-7953 R9802.

PAPER NO. 84: P.V. Nielsen: *Airflow in a World Exposition Pavilion Studied by Scale-Model Experiments and Computational Fluid Dynamics*. ISSN 1395-7953 R9825.

PAPER NO. 85: P.V. Nielsen: *Stratified Flow in a Room with Displacement Ventilation and Wall-Mounted Air Terminal Devices*. ISSN 1395-7953 R9826.

PAPER NO. 86: P.V. Nielsen: *The Selection of Turbulence Models for Prediction of Room Airflow*. ISSN 1395-7953 R9828.

PAPER NO. 87: K. Svidt, G. Zhang, B. Bjerg: *CFD Simulation of Air Velocity Distribution in Occupied Livestock Buildings*. ISSN 1395-7953 R9831.

PAPER NO. 88: P. V. Nielsen, T. Tryggvason: *Computational Fluid Dynamics and Building Energy Performance Simulation*. ISSN 1395-7953 R9832.

PAPER NO. 89: K. Svidt, B. Bjerg, S. Morsing, G. Zhang: *Modelling of Air Flow through a Slatted Floor by CFD*. ISSN 1395-7953 R9833.

PAPER NO. 90: J.R. Nielsen, P.V. Nielsen, K. Svidt: *The Influence of Furniture on Air Velocity in a Room - An Isothermal Case*. ISSN 1395-7953 R9843.

PAPER NO. 91: P. Lengweiler, J.S. Strøm, H. Takai, P. Ravn, P.V. Nielsen, A. Moser: *Dust Load on Surfaces in Animal Buildings: An Experimental Measuring Method*. ISSN 1395-7953 R9844.

PAPER NO. 92: P. Lengweiler, P.V. Nielsen, A. Moser, P. Heiselberg, H. Takai: *Deposition and Resuspension of Particles: Which Parameters are Important?* ISSN 1395-7953 R9845.

PAPER NO. 93: C. Topp, P.V. Nielsen, P. Heiselberg, L.E. Sparks, E.M. Howard, M. Mason: *Experiments on Evaporative Emissions in Ventilated Rooms*. ISSN 1395-7953 R9835.

PAPER NO. 94: L. Davidson, P.V. Nielsen: *A Study of Low-Reynolds Number Effects in Backward-Facing Step Flow using Large Eddy Simulations*. ISSN 1395-7953 R9834.

Complete list of papers: <http://iee.civil.auc.dk/i6/publ/iee.html>

Examine

ISSN 1395-7953 R9835

Dept. of Building Technology and Structural Engineering

Aalborg University, December 1998

Sohngaardsholmsvej 57, DK-9000 Aalborg, Denmark

Phone: +45 9635 8080 Fax: +45 9814 8243

<http://iee.civil.auc.dk>